




# REGULATOR SETUP

For the equipment to function correctly, the proper regulator setup is required. For any unit, 7"-14" Water Column is necessary at the supply to the unit.

- 1 REG 1: 50276B
- 2 REG 2: 50276A

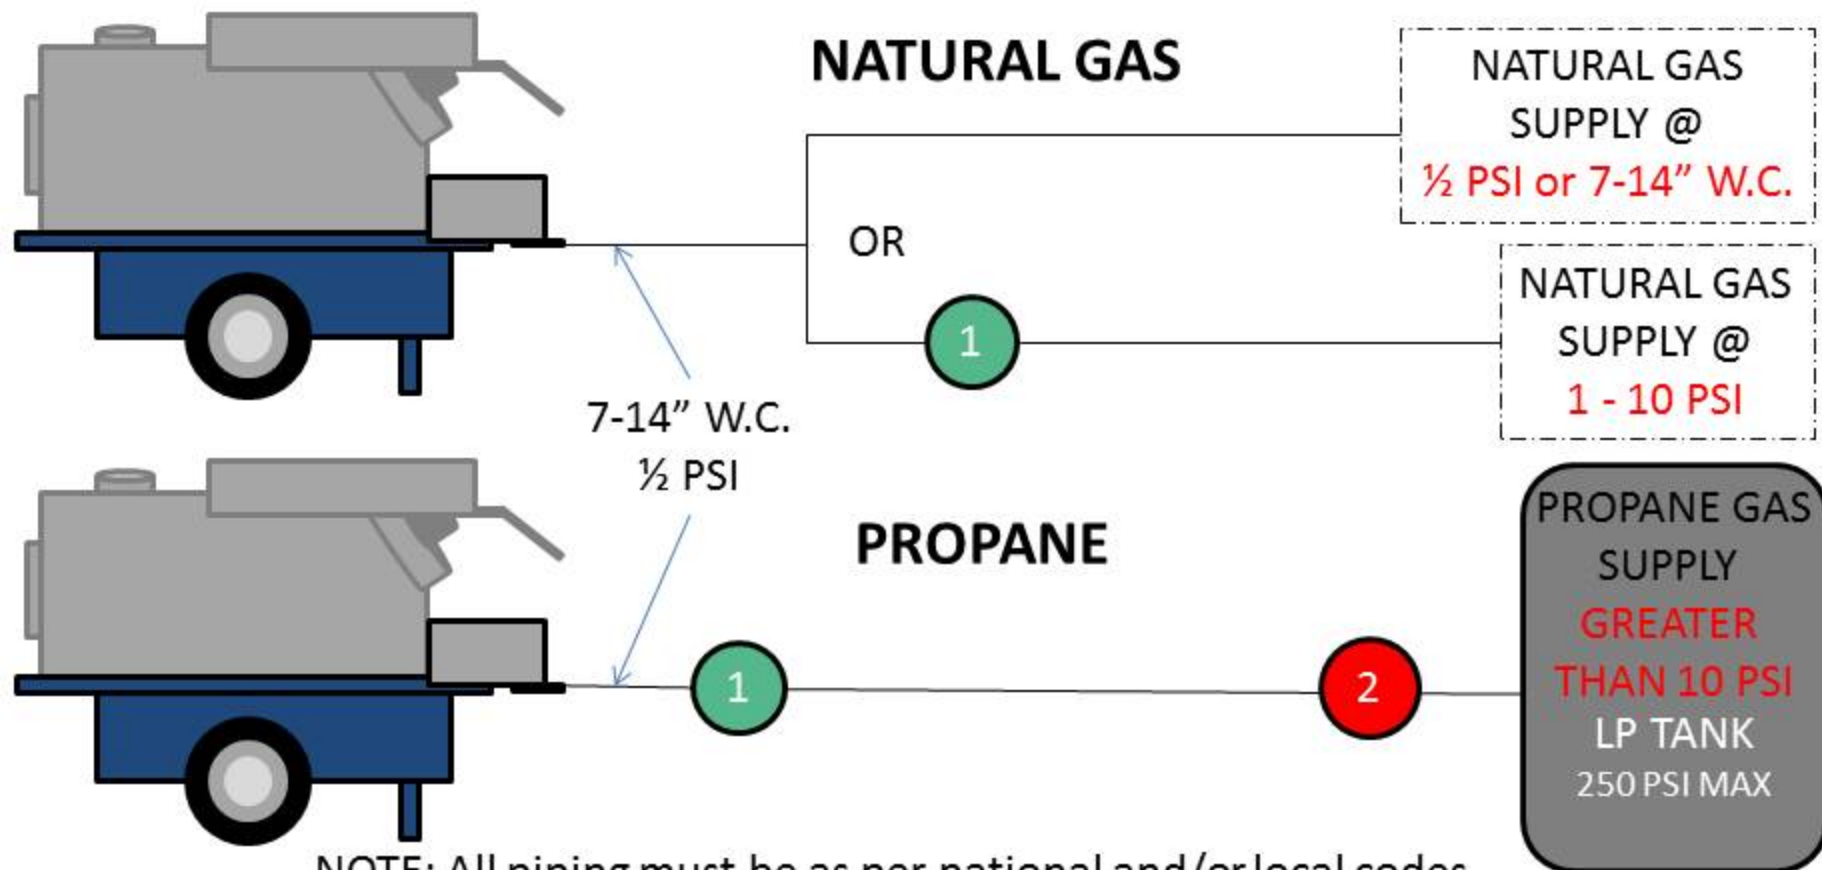

NOTE: All piping must be as per national and/or local codes.