


FROST *Fighter*

LP/NG REGULATOR SETUP


For the equipment to function correctly, the proper regulator setup is required. For all IDF series systems, a pressure of ½" PSI or 7"-14" water column is necessary at the units intake.

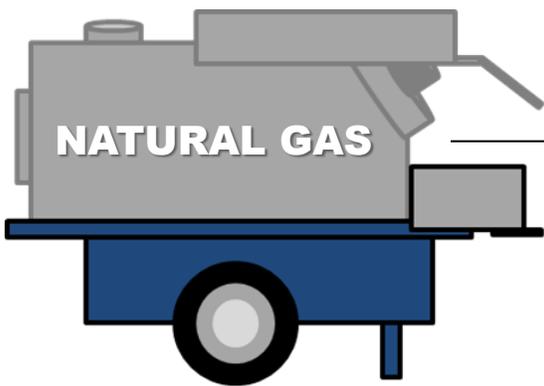

IF NATURAL GAS SUPPLY
Pressure is ..
½ PSI or 7 - 14" W.C.


2

IF NATURAL GAS SUPPLY
Pressure is ..
1 - 10 PSI

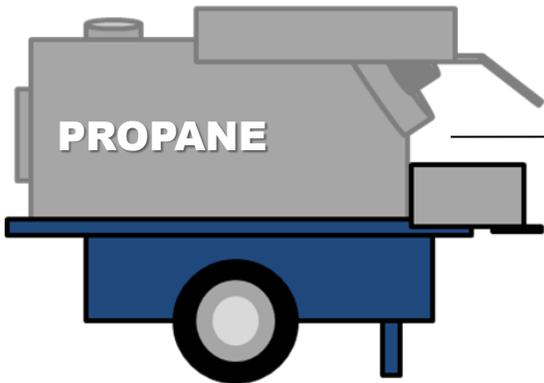

If Propane Gas
Supply is ..

GREATER Than 10 PSI
LP Tank Greater Than
250 PSI MAX

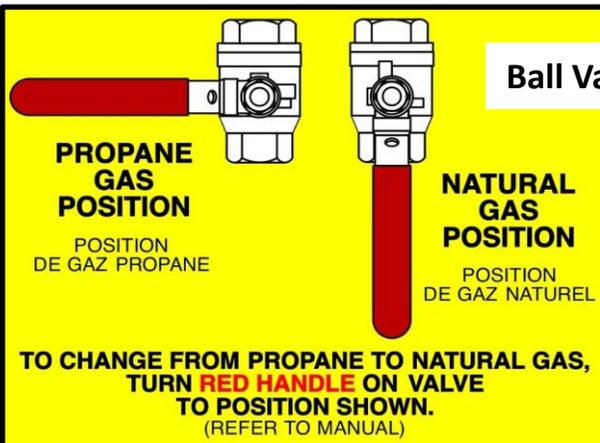

- **REGULATORS** -

- 1** 1st Stage 50276A
- 2** 2nd Stage 50274A

NOTE:

All piping must be as per national and/or local codes.